


# Single Phase Residential Installation: Overhead Mast Pipe

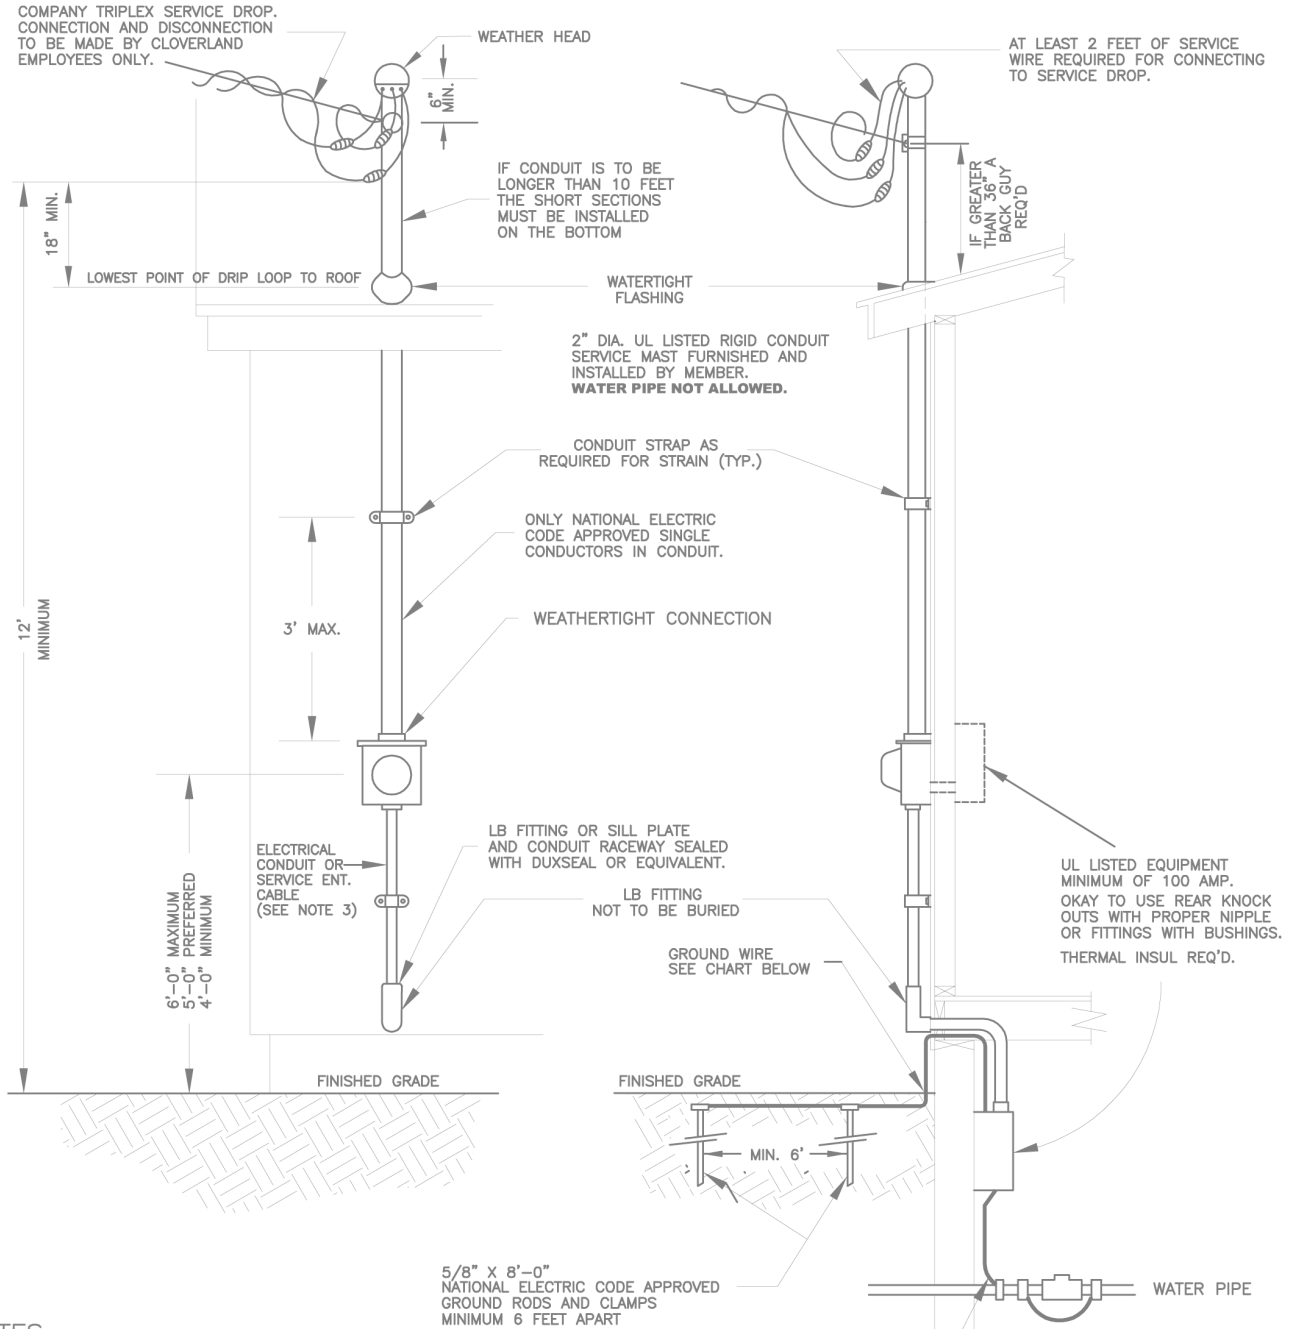

## NOTES

1. MEMBER SHALL INSTALL METER SOCKET SUPPLIED BY CLOVERLAND ELECTRIC, AT THE APPROVED LOCATION ON THE BUILDING. MEMBER SHALL FURNISH AND INSTALL THE SERVICE ENTRANCE WIRING AND ASSOCIATED MATERIAL FOR INSTALLATION.
2. SERVICES MUST BE INSPECTED AND APPROVED BY AN ELECTRICAL INSPECTOR BEFORE CONNECTION.
3. SERVICE CABLES, WHERE SUBJECT TO PHYSICAL DAMAGE, SHALL BE INSTALLED IN CONDUIT.
4. APPLY OXIDE INHIBITING COMPOUND TO ALL ALUMINUM CONNECTIONS.

## DISCLAIMER

This drawing should be used only as a guide. It is the member's responsibility to ensure the project complies with the most recent issue of the NEC and any other federal, state or local codes that apply.

SERVICE	ALUM.	COPPER	GND WIRE
100 AMP.	#2	#4	#6 Cu
125 AMP.	1/0	#2	#6 Cu
150 AMP.	2/0	#1	#6 Cu
200 AMP.	4/0	2/0	#4 Cu